

DATA SHEET

CSE MIX R8 1F Pump Station



Main Features	
Application	Providing circulation and mixing of a heating circuit or solid fuel fired source circuit. Switching of the circulation pump and control of the mixing valve is realized from an external controller, which is not included.
Description	Consist of RPA 25-8 pump, LK 840 3-way mixing valve w. AVC actuator, insulation.
Working fluid	Water, water-glycol mixture (max. 1:1) – pH 6.5-8.5. We recommend placing a filter with a mesh size of max. 0.6 mm upstream of the pump – e.g. Magnetfilterball – see the Catalogue for codes.
Installation	Flow pipe to heating circuit / on solid fuel boiler return pipe, min. pipe centre distance from wall is 100 mm.
Code	21124

Pump Station Data	
Fluid working temperature	5–95 °C
Max. working pressure	10 bar
Min. working pressure	0.5 bar
Ambient temperature	5–40 °C
Max. relative humidity	80 % non condensing
Mixing valve Kvs	10 m³/h
Valve Leakage rate	< 1 % Kvs at 5 mH ₂ O pressure difference
Drive torque	5 Nm
Drive rotation angle	90°
Actuator shift time	120 s
Actuator control	3-point (SPDT)
Actuator auxiliary switch	none
Overall dimensions	305 x 135 x 195 mm
Total weight	3.9 kg
Connections	3 x G 1" F

Electric Data		
Power supply	230 V, 50 Hz	
Max. pump power input	65 W	
Max. pump current	0,65 A	
Actuator max. power input	2.5 VA	

Materials		
Insulation	EPP RG 60 g/l	
Mixing valve and fittings	brass	

Tel.: +420 241 765 191


Fax: +420 241 763 976




DATA SHEET

CSE MIX R8 1F Pump Station


Pump performance curves

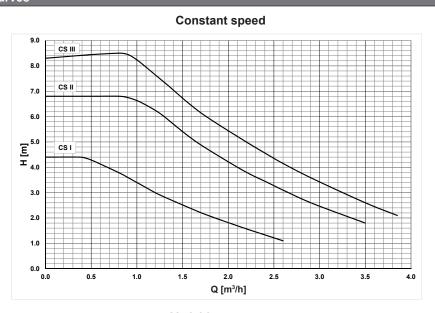

Variable pressure

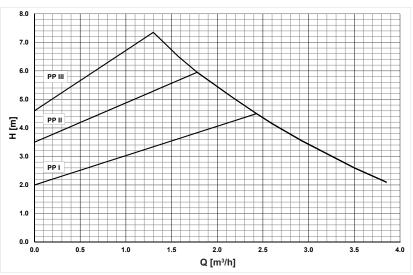

Constant pressure

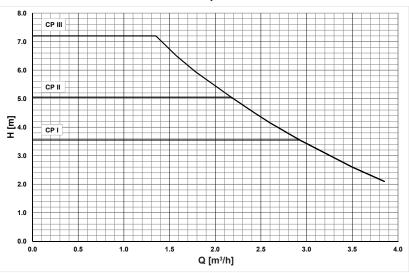


Tel.: +420 241 765 191

Fax: +420 241 763 976




DATA SHEET


CSE MIX R8 1F Pump Station

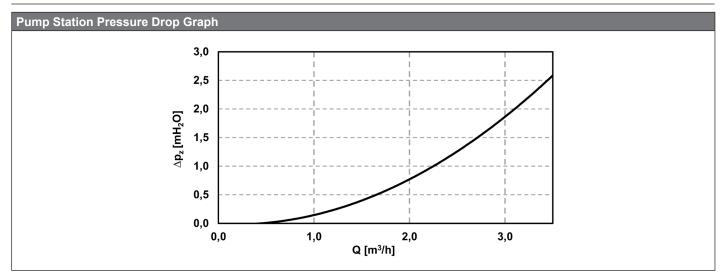


Tel.: +420 241 765 191

Fax: +420 241 763 976

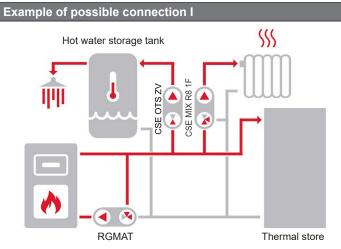



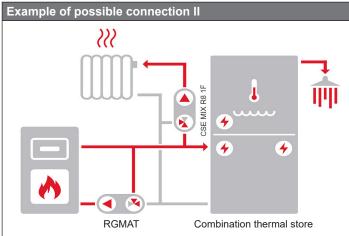

The diagram shows a typical connection of a solid fuel boiler (with the recommended RGMAT pump station – not included in supply), combination thermal store and heating circuit.