

DATA SHEET

EcoPart 417 Ground-to-water Heat Pump



| Main Features | |
|----------------------------|---|
| Application | Space and DHW heating. |
| Description | The heat pump exploits the energy potential of the ground, pumps the energy obtained through deep boreholes or ground collectors to a higher temperature and transfers it to the heating water; the flow temperature can reach as much as 65 °C. |
| Installation ¹⁾ | A heating system circulation pump, a ground circuit circulation pump, ground circuit buffer tank and ground circuit filling kit are included in supply; it is necessary to install the heat pump with a smart controller (for codes see the Catalogue). |
| Working fluid | R407C (refrigerant c.), antifreeze fluid (brine c.), water (heating system). |
| Certification | HP Keymark – quality label by the European Committee for Standardization (CEN). |
| Code | 12652 |

1) In case of more heat pumps connected in a cascade, only the first heat pump shall be installed with a smart controller.

| Technical Data | |
|---|--------------------------|
| Output ²⁾ | 16.76 kW |
| Power input ²⁾ | 3.71 kW |
| COP ²) | 4.52 |
| Nominal current | 13.9 A |
| Power supply | 3/N/PE ~ 400 V 50 Hz |
| Recommended circuit breaker | B16A 3f |
| IP rating | IPX1 |
| Compressor | Scroll |
| Refrigerant | R 407C (GWP 1774) |
| Refrigerant quantity | 2.7 kg |
| CO2 equivalent ³⁾ | 4.790 t |
| Compressor oil | Polyoester (POE) |
| Refrigerant max. working pressure | 31 bar |
| Brine system min./max. temperature | –5 °C / 20 °C |
| Brine system min./max. pressure | 0.2 bar / 3.0 bar |
| Antifreeze fluid volume in heat pump | 4.1 |
| Brine system min. flow (Δt = 5 K) | 2270 l/h |
| Brine system nominal flow (Δt = 3 K) | 3780 l/h |
| Brine pump | UPMXL GEO 25-125 180 PWM |
| Brine circuit connection | 2 x Cu 28 x 1.5 |
| Max. heat pump flow temperature | 65 °C |
| Max. heating water temperature in space heating system | 110 °C |
| Max. working pressure of heating water | 3 bar |
| Heating water volume in heat pump | 3.4 |
| Min. surface area of heat exchanger in tank | 5 m² |
| Min. flow rate through heat pump (Δt = 10 K at 0/35 °C) | 1440 l/h |
| Nom. flow rate through heat pump ($\Delta t = 5 \text{ K at } 0/35 ^{\circ}\text{C}$) | 2920 l/h |
| Heating system pump | UPM GEO 25-85 130 |
| Heating system connection | 2 x Cu 28 x 1.5 |
| Weight | 168 kg |

2) At B0/W35 temperatures. 3) Is not covered by the annual check for leaking refrigerant (EU No 517/2014).

| , , , | , |
|---|----------|
| Parameters for distribution tariff change | |
| Nominal power input (required input) | 5.37 kW |
| Heat output ⁴⁾ | 16.76 kW |
| Steady current ⁴⁾ | 6.0 A |
| Starting current | 32.0 A |
| Nominal voltage / number of phases | 400 V 3f |

Tel.: +420 241 765 191

Fax: +420 241 763 976

4) At B0/W35 temperatures.



DATA SHEET


EcoPart 417 Ground-to-water Heat Pump

| Energy efficiency data (for low-temperature applications under average climatic co | anditions, others see the Product Fiche) | |
|--|--|--|
| Seasonal Energy Efficiency | 181% | |
| Energy Efficiency Class | A+++ | |
| SCOP | 4.70 | |

| Sound data | | |
|--------------------------------|------------|--|
| Sound power level by EN 12 102 | 55,5 dB(A) | |

| Output parameters ⁵⁾ | | | | | |
|----------------------------------|------------------|-------------|------------------|---------|--|
| Brine system temperature | Flow temperature | Output [kW] | Power input [kW] | COP [-] | |
| | 35 °C | 19.25 | 3.83 | 5.03 | |
| 5 °C | 45 °C | 18.42 | 4.55 | 4.05 | |
| | 55 °C | 18.16 | 5.37 | 3.38 | |
| 25 °C 35 °C 45 °C 55 °C | 25 °C | _ | _ | _ | |
| | | 16.76 | 3.71 | 4.52 | |
| | | 16.14 | 4.47 | 3.61 | |
| | 55 °C | 15.87 | 5.17 | 3.07 | |
| −5 °C | 45 °C | 14.05 | 4.40 | 3.19 | |


⁵⁾ The values of working parameters are measured according to EN 14 511 at the manufacturer's test lab.

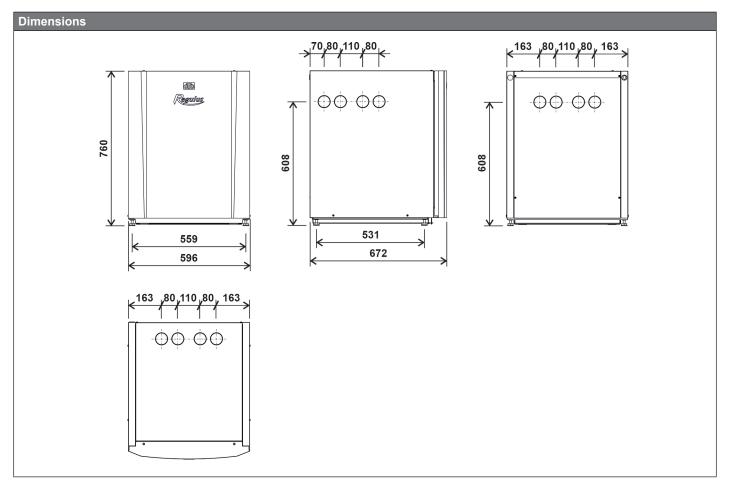


Tel.: +420 241 765 191



DATA SHEET EcoPart 417 Ground-to-water Heat Pump

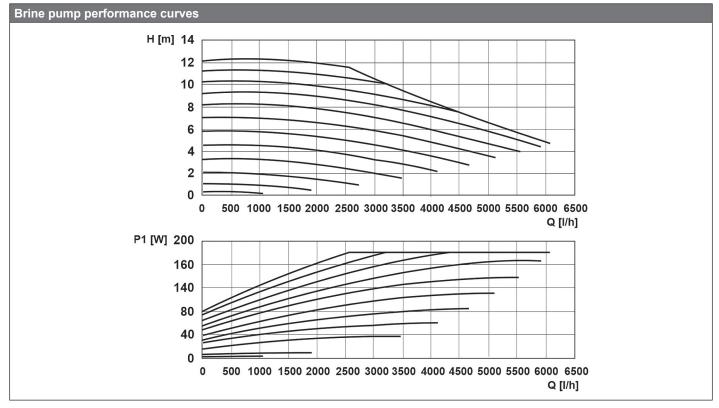

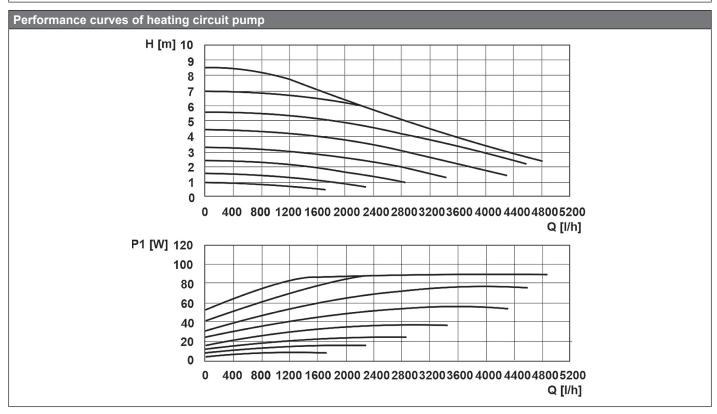


Tel.: +420 241 765 191



DATA SHEET

EcoPart 417 Ground-to-water Heat Pump

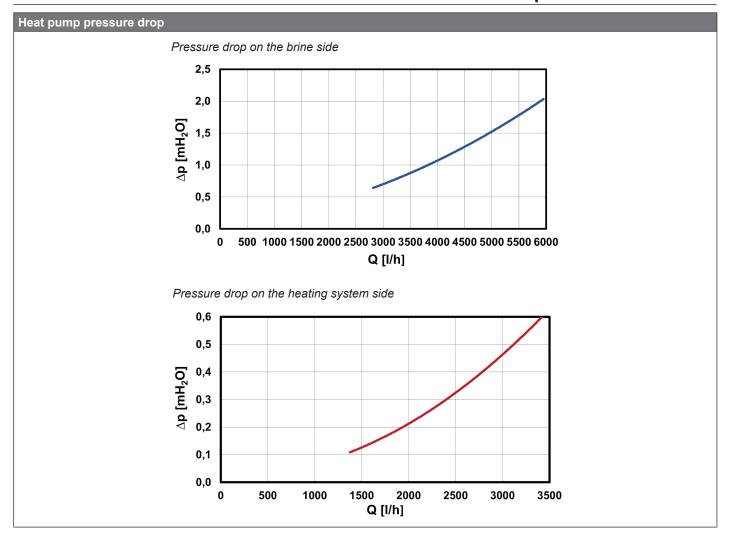

Tel.: +420 241 765 191



PRODUCT FICHE

EcoPart 417 Ground-to-water Heat Pump

Supplier's nameR E G U L U S spol. s. r. o.Supplier's model identifierCTC EcoPart 417

| Parameter | low temperature | medium temperature |
|---|-----------------------------|------------------------------|
| The seasonal space heating energy efficiency class | A+++ | A++ |
| Average climate | | |
| The rated heat output including any suplementary heaters The seasonal space heating energy efficiency The annual energy consumption | 19 kW 181 % 8 362 kWh | 18 kW 137 % 10 284 kWh |
| Cold climate | | |
| The rated heat output including any suplementary heaters The seasonal space heating energy efficiency The annual energy consumption | 18 kW 181 % 9 166 kWh | 17 kW 140 % 11 554 kWh |
| Warm climate | | |
| The rated heat output including any suplementary heaters The seasonal space heating energy efficiency The annual energy consumption | 18 kW 180 % 5 180 kWh | 17 kW 137 % 6 315 kWh |
| The sound power level LWA, outdoors | | 56 dB |

Any specific precautions that shall be taken when the space heater is assembled, installed or maintained are stated in the manual thar is a part of the supply.

| Model: | CTC EcoPart 417 |
|-------------------------------------|-----------------|
| Air-to-water heat pump: | no |
| Water-to-water heat pump: | no |
| Brine-to-water heat pump: | yes |
| Low-temperature heat pump: | no |
| Equipped with supplementary heater: | no |
| Heat pump combination heater: | no |

Parameters declared for medium-temperature application and average climate.

| Item | Symbol | Value | Unit | Item | Symbol | Value | Unit |
|---|--------------------|------------|------|---|--------------------|---------------|------|
| Rated heat output (*) | P _{rated} | 18 | kW | Seasonal space heat. ener. efficiency | η_{s} | 137 | % |
| Declared capacity for heating for part loa | | nperature | | Declared coefficient of performance or pro- | imary energy i | atio for part | load |
| 20 °C and outdoor temperature Tj: | | | | at indoor temperature 20 °C and outdoor | temperature 7 | <u>;</u> : | |
| Tj = -7 °C | P_{dh} | 16.00 | kW | Tj = -7 °C | COP | 3.23 | _ |
| Tj = +2 °C | P _{dh} | 16.10 | kW | Tj = +2 °C | COP _d | 3.6 | _ |
| Tj = +7 °C | Pdh | 16.40 | kW | Tj = +7 °C | COP | 3.97 | _ |
| Tj = +12 °C | P_{dh}^{dh} | 16.70 | kW | Tj = +12 °C | COPd | 4.36 | _ |
| Tj = bivalent temperature | P _{dh} | 16.00 | kW | Tj = bivalent temperature | COPd | 3.23 | _ |
| Tj = operation limit temperature | P_{dh}^{dh} | - | kW | Tj = operation limit temperature | COPd | - | _ |
| For air-to-water heat pumps: Tj = -15 °C, pokud TOL < -20 °C | P _{dh} | - | kW | For air-to-water heat pumps: Tj = -15 °C, pokud TOL < -20 °C | COPd | - | _ |
| Bivalent temperature | T_{biv} | - 7 | °C | For air-to-water heat pumps: operation limit temperature | T_{OL} | - | °C |
| Cycling interval capacity for heating | P _{cyc} | _ | kW | Cycling interval efficiency | COP _{cyc} | _ | _ |
| Degradation co-efficient (**) | C_{dh}^{cyc} | 0.99 | - | Heating water operating limt temp. | W _{TOL} | 65.00 | °C |
| Power consumption in modes other than | active mode: | | | Supplementary heater: | | | |
| Off mode | P_{OFF} | 0.018 | kW | [[" | | | |
| Thermostat-off mode | $P_{TO}^{(1)}$ | 0.008 | kW | Rated heat output (*) | P_{sup} | 2.20 | kW |
| Standby mode | P _{SB} | 0.018 | kW | | sup | | |
| Crankcase heater mode | P _{ck} | 0.000 | kW | Type of energy input | | electric | |
| Other items: | | | | For air-to-water heat pumps: | | | 3//- |
| capacity control | | fixed | | rated air flow rate, outdoors | | - | m³/h |
| | | | | For water/brine-to-water heat pumps: | | | |
| Sound power level, | 1 | 56 / – | dB | Rated brine or water flow rate, | | 3.10 | m³/h |
| indoors / outdoors | L _{WA} | 307- | UD | outdoor heat exchanger | | | |

Contact details Enertech AB, Box 309, SE-341 26 Ljungby, Sweden www.ctc.se

(*) For heat pump space heaters and heat pump combination heaters, the rated heat output Prated is equal to the design load for heating Pdesignh, and the rated heat output of a supplementary heater

Tel.: +420 241 765 191

Psup is equal to the capacity for heating sup(Tj).

(**) If Cdh is not determined by measurement then the default degradation is Cdh = 0,9.