

DATA SHEET

RegulusBOX 12 CTC 3/3 Indoor Unit for CTC Heat Pumps



RegulusBOX is wall-hung indoor unit designed for easy connecting CTC heat pumps to a house heating system. A stainless-steel hot water storage tank NBC 170HP can be easily installed below RegulusBOX With inverter heat pumps, RegulusBOX can be connected directly to a heating system, with ONOFF heat pump models or for more heating circuits it shall be installed with a (combination) thermal store and a pump station for each heating system circuit. Basic Elements of RegulusBOX Unit I R RegulusBOX Controller with remote access from a computer or mobile app control unit with display (equipped with temperature and humidity sensors) that can be removed and used as a room unit with two-wire connection; in that case, a display blind plug (code 18248) shall be bought as well electric boiler with an output of 12 kW switched in steps of 2 kW (maximum output can be limited) Wilo Para 25/8 iPWM1 circulation pump three-way motorized valve for switching the outputs of the heating system and DHW heating pressure sensor for heating system pressure monitoring automatic air vent valve terminal block for connecting the heat pump and other accessories circuit breaker for heat pump circuit breaker for heat pump circuit breaker for heat pump circuit breaker for heaty pump interested Accessories mounting kit for easy installation on the wall rail ""Fum ball valve for output to the HW storage tank control lever for ball valves ball valve with filter and magnet for installation in the heat pump return pipe outdoor temperature sensor for hot water storage tank control lever for ball valves ball valve with filter and magnet for mobile phones; integrated control unit with oLED display and 6 capacitive buttons, with temperature and humidity sensor; the unit can be moved indoors and used as a room control unit Working fluid water, anti		•
system. A stainless-steel hot water storage tank NBC 170HP can be easily installed below RegulusBOX With inverter heat pumps, RegulusBOX can be connected directly to a heating system, with ON/OFF heat pump models or for more heating circuits it shall be installed with a (combination) themal store and a pump station for each heating system circuit. Basic Elements of RegulusBOX unit IR RegulusBOX Controller with remote access from a computer or mobile app control unit with display (equipped with temperature and humidity sensors) that can be removed and used as a room unit with two-wire connection; in that case, a display blind plug (code 18248) shall be bought as well electric boiler with an output of 12 kW switched in steps of 2 kW (maximum output can be limited) Wilo Para 25/8 iPWM1 circulation pump three-way motorized valve for switching the outputs of the heating system and DHW heating pressure sensor for heating system pressure monitoring automatic air vent valve terminal block for connecting the heat pump and other accessories circuit breaker for heat pump circuit breaker for heat pump circuit breaker for heat pump circuit breaker for heating system 1" Fu/M ball valve (or easy installation on the wall rail 1" Fu/F ball valve for output to the heating system 1" Fu/M ball valve for output to the heating system 1" Fu/M ball valve for output to the HW storage tank control lever for ball valves ball valve for output to the HW storage tank control lever for ball valves ball valve for output to the heating system 1" Fu/M ball valve for output to the heating system 1" Fu/M ball valve for output to the heating system 1" Fu/M ball valve for output to the heating system 1" Fu/M ball valve for output to the heating system 1" Fu/M ball valve for output to the heating system 1" Fu/M ball valve for output to the heating system 1" Fu/M ball valve for output to the heating system 1" Fu/M ball valve for output to the heating system 1" Fu/M ball valve for output to th	Main Features	
IR RegulusBOX Controller with remote access from a computer or mobile app control unit with display (equipped with temperature and humidity sensors) that can be removed and used as a room unit with two-wire connection; in that case, a display blind plug (code 18248) shall be bought as well electric boiler with an output of 12 kW switched in steps of 2 kW (maximum output can be limited) Wilo Para 25/8 iPWM1 circulation pump three-way motorized valve for switching the outputs of the heating system and DHW heating pressure sensor for heating system pressure monitoring automatic air vent valve terminal block for connecting the heat pump and other accessories circuit breaker for heat pump circuit breaker for the controller Enclosed Accessories mounting kit for easy installation on the wall rail 1" Fu/F ball valve with safety group to connect an expansion vessel with safety and drain valves 1" Fu/F ball valve for output to the heating system 1" Fu/F ball valve for output to the HW storage tank control lever for ball valves ball valve with filter and magnet for installation in the heat pump return pipe outdoor temperature sensor temperature sensor for hot water storage tank mounting template wall rail integrated web server for remote management, accessible via LAN or over the Internet via Regulusroute service; website is optimized for mobile phones; integrated control unit with OLED display and 6 capacitive buttons, with temperature and humidity sensor; the unit can be moved indoors and used as a room control unit with OLED display and 6 capacitive buttons, with temperature and humidity sensor; the unit can be moved indoors and used as a room control unit with OLED display and 6 capacitive buttons, with temperature and humidity sensor; the unit can be moved indoors and used as a room co	Application	system. A stainless-steel hot water storage tank NBC 170HP can be easily installed below RegulusBOX With inverter heat pumps, RegulusBOX can be connected directly to a heating system, with ON/OFF heat pump models or for more heating circuits it shall be installed with a (combination) thermal store
Regulusroute service; website is optimized for mobile phones; integrated control unit with OLED display and 6 capacitive buttons, with temperature and humidity sensor; the unit can be moved indoors and used as a room control unit Working fluid water, antifreeze heat-transfer fluid for heating systems RegulusBOX is designed for installation with CTC EcoAir / CTC EcoPart heat pumps. If used with EcoPart 414, 417, 612 and 616, the circulation pump needs to be removed from the heat pump and replaced by a pipe extension (code 17391). Install RegulusBOX indoors only. to heat pump – G 1" F to heating system – G 1" F to heat exchanger in HW tank TV – G 1" M to expansion vessel – G 3/4" M	Description	 ■ IR RegulusBOX Controller with remote access from a computer or mobile app ■ control unit with display (equipped with temperature and humidity sensors) that can be removed and used as a room unit with two-wire connection; in that case, a display blind plug (code 18248) shall be bought as well ■ electric boiler with an output of 12 kW switched in steps of 2 kW (maximum output can be limited) ■ Wilo Para 25/8 iPWM1 circulation pump ■ three-way motorized valve for switching the outputs of the heating system and DHW heating ■ pressure sensor for heating system pressure monitoring ■ automatic air vent valve ■ terminal block for connecting the heat pump and other accessories ■ circuit breaker for heat pump ■ circuit breaker for the controller Enclosed Accessories ■ mounting kit for easy installation on the wall rail ■ 1" Fu/F inlet ball valve with safety group to connect an expansion vessel with safety and drain valves ■ 1" Fu/F ball valve for output to the heating system ■ 1" Fu/B ball valve for outlet to the HW storage tank ■ control lever for ball valves ■ ball valve with filter and magnet for installation in the heat pump return pipe ■ outdoor temperature sensor ■ temperature sensor for hot water storage tank ■ mounting template
RegulusBOX is designed for installation with CTC EcoAir / CTC EcoPart heat pumps. If used with EcoPart 414, 417, 612 and 616, the circulation pump needs to be removed from the heat pump and replaced by a pipe extension (code 17391). Install RegulusBOX indoors only. to heat pump – G 1" F to heating system – G 1" F to heat exchanger in HW tank TV – G 1" M to expansion vessel – G 3/4" M	Interface	Regulusroute service; website is optimized for mobile phones; integrated control unit with OLED display and 6 capacitive buttons, with temperature and humidity sensor; the unit can be
Installation If used with EcoPart 414, 417, 612 and 616, the circulation pump needs to be removed from the heat pump and replaced by a pipe extension (code 17391). Install RegulusBOX indoors only. to heat pump – G 1" F to heating system – G 1" F to heat exchanger in HW tank TV – G 1" M to expansion vessel – G 3/4" M	Working fluid	water, antifreeze heat-transfer fluid for heating systems
to heating system – G 1" F to heat exchanger in HW tank TV – G 1" M to expansion vessel – G 3/4" M	Installation	If used with EcoPart 414, 417, 612 and 616, the circulation pump needs to be removed from
Code 18054 – Czech menu / 18928 – English menu	Connection Dimensions*)	to heating system – G 1″ F to heat exchanger in HW tank TV – G 1″ M
	Code	18054 – Czech menu / 18928 – English menu

Tel.: +420 241 765 191

Fax: +420 241 763 976

E-mail: sales@regulus.eu Web: www.regulus.eu

^{*)} With ball valves from accessory installed.



DATA SHEET

RegulusBOX 12 CTC 3/3 Indoor Unit for CTC Heat Pumps

Technical Data		
Fluid working temperature	5–90 °C	
Max. working pressure	3 bar	
Min. working pressure	0.5 bar	
Ambient temperature	5–40 °C	
Max. relative humidity	80 %, non condensing	
Safety valve set pressure	3 bar	
Safety valve seat cross section	132 mm ²	
Safety valve discharge coefficient	0.3	
3-way valve actuator run time	15 s	
Fluid volume	10	
Total weight without heating water	34 kg	
Total weight with heating water	44 kg	
Overall dimensions (W x H x D)	560 x 905 x 235 mm	

Electric Data	
Power supply	3/N/PE ~ 400 / 230 V 50 Hz
Max. cross section of power cable	4 mm² (stranded) / 6 mm² (solid)
Nominal power input	12.2 kW (without heat pump connected)
Heating elements	2 x 6 kW (3 x 2 kW each – 230 V)
IP rating	IP20
Limitation of max. current to the connected heat pump	16 A (limited by controller)
Circuit breaker for heat pump	B16A 3f
Circuit breaker for controller, zone valve actuator, pump	B6A 1f

Connectivity, Memory Card	
Ethernet 100 Mbit/s	2 x
USB for connecting an optional WiFi USB adapter	1 x
RS485 for connecting a heat pump	1 x
CIB	1 x
TCL2	1 x
Micro SD memory card	1 x


Inputs and Outputs for optional Accessories				
2 x relay outputs*)	230 V/5A (K4, K5)			
3 x PWM outputs	24 V DC (AO0, AO1, PWM3)			
4 x analog outputs	0–10 V (AO2-AO5)			
1 x output for three-way valve control	230 V AC (K2, L2 IR)			
1 x input for Ripple control	230-400 V AC (HDO)			
1 x input for iPWM return signal from circulation pumps	A/DI16			
15 x inputs for Pt1000 temperature sensors**)	measuring range -90 to 400 °C (A/DI0-A/DI13 a A/DI20)			

Tel.: +420 241 765 191

Fax: +420 241 763 976

^{**)} Inputs can also be used as binary potential-free inputs to connect e.g. an instantaneous circulation switch or a boost switch of the HRV unit etc.



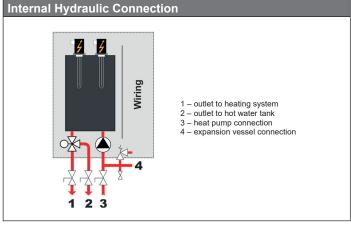

^{*)} Can be optionally extended with 4x relay output by using the 4x RO module kit (code 19401).


E-mail: sales@regulus.eu

Web: www.regulus.eu



DATA SHEET

RegulusBOX 12 CTC 3/3 Indoor Unit for CTC Heat Pumps

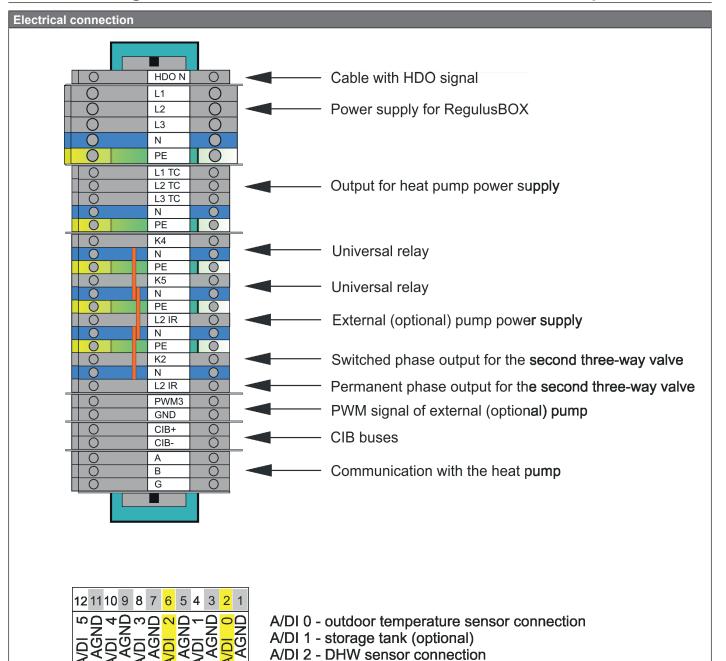

A/DI 3 - Pt1000 room sensor (optional)


Tel.: +420 241 765 191


Fax: +420 241 763 976




DATA SHEET

RegulusBOX 12 CTC 3/3 Indoor Unit for CTC Heat Pumps

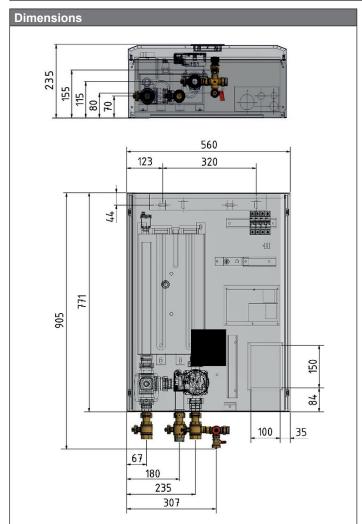

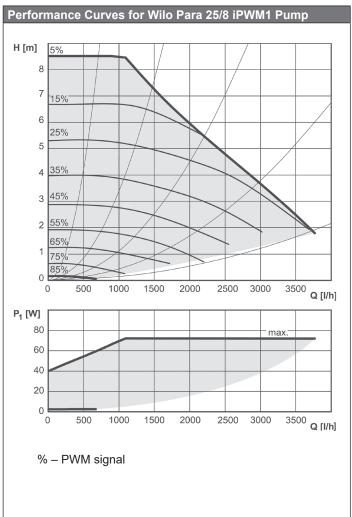

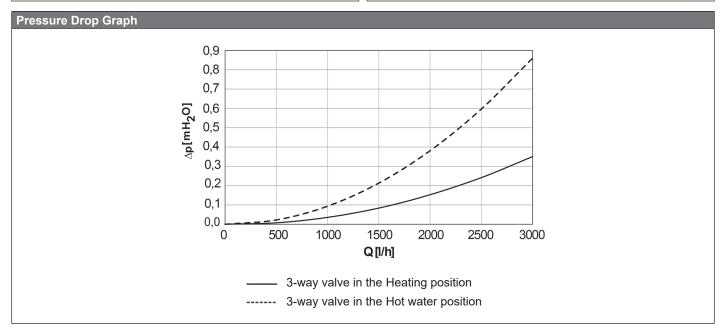

Tel.: +420 241 765 191

Fax: +420 241 763 976