

www.regulus.eu



Installation and Operation Manual CSE MIX W PWM 1F PUMP STATION with mixing valve

**EN** 

#### 1. Introduction

CSE MIX W PWM 1F pump station is designed to be installed in heating circuits where it provides heating water mixing and circulation through the circuit. Its typical application is in mixed heating circuits in buildings where it provides circulation and mixing of heating water to a desired temperature, or for solid-fuel boiler circuits where it provides circulation and mixing to a min. heating water temperature as a protection against low-temperature corrosion. Actuator of the mixing valve is controlled by an external controller through 3-point control with 230VAC outputs. The circulation pump is switched by an external controller, the pump speed controlled by PWM signal, with no PWM signal the pump runs at max. speed. The controller is not included in supply. The pump station is designed to be installed directly on the pipe, with 100 mm min. distance of the pipe axis from a wall.

### 2. Description

The Pump Station consists of Wilo Yonos PARA RS 25/7.5 PWM1 pump incl. power cable and PWM cable, 3-way mixing valve with actuator incl. power cable, ball valve, insulation

Main features	
Application	control of output into a mixed heating circuit through an external Controller or control of a solid fuel boiler return line; pump speed controlled by PWM signal; with no PWM signal the pump runs at max. speed
Description	consists of Wilo Yonos PARA RS 25/7.5 PWM1 pump, LK 840 3-way mixing valve with AVC actuator, insulation
Working fluid	water, water-glycol mixture (max. 1:1), water-glycerine mixture (max. 2:1)
Installation	on a flow pipe to heating circuit / solid fuel boiler return pipe, min. pipe centre distance from wall is 100 mm
Code	17 281

Data for CSE MIX W PWM 1F Pump Station		
Fluid working temperature	5 - 100 °C	
Max. working pressure	6 bar	
Ambient temperature	5 - 40 °C	
Max. relative humidity	95 %, non condensing	
Power supply	230 V, 50 Hz	
Insulation material	EPP RG 60 g/l	
Overall dimensions	325 x 140 x 220 mm	
Total weight	3,4 kg	
Connections	3 x G1"F	

## 3. Installation options

The pump station comes with a mixing valve in the left-hand position (see Fig. 1). If this installation position is convenient, there is no need to make any adjustments. When needed, the mixing valve can be rotated to the right-hand position (see Fig. 2). After the valve is turned by 180° and the fittings tightened, the actuator lock shall be unscrewed and screwed into the opening at the other valve side (see Fig. 2) and the position of the valve member and actuator changed (see the paragraph and pictures below).

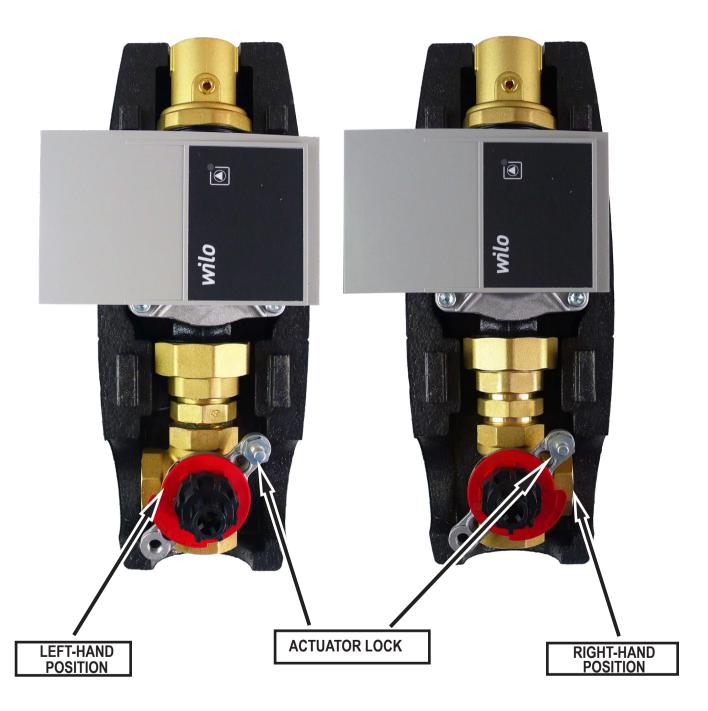


Fig. 1 Fig. 2

# **Actuator adjustment**

Having turned the valve to the right hand position, turn the D-shaft in such a manner that the valve member is between inlets 1 and 3, turn the plastic red wheel into its proper position (see Fig. 4), and finally fit the plastic adapter (see Fig. 4).

The flat edge of the shaft and the arrow on the plastic adapter are located on the same side as the valve member!

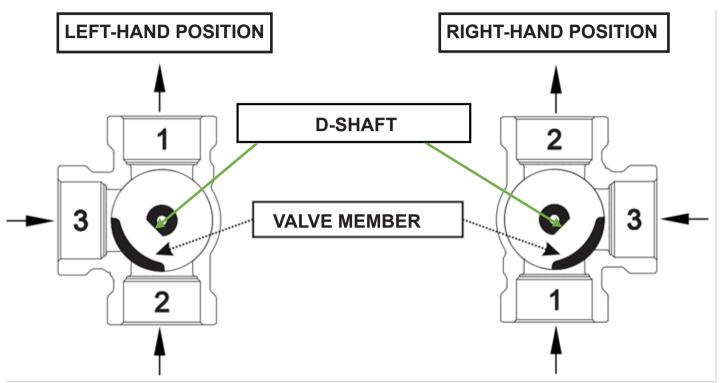


Fig. 3

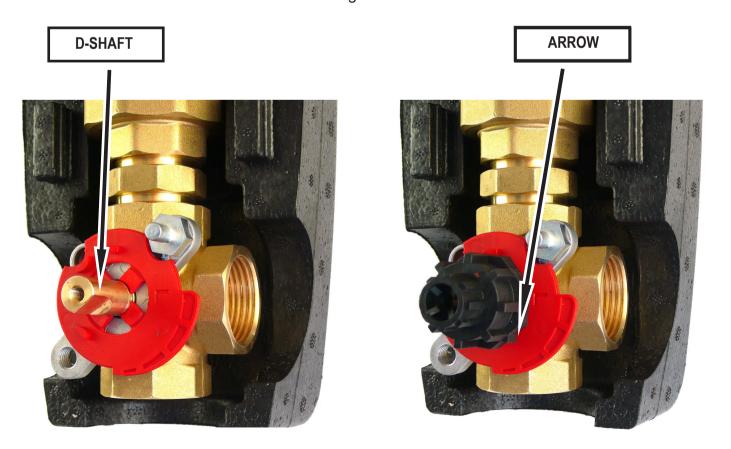


Fig. 4

Prior to fitting the actuator on the plastic adapter, switch it to manual control, set the control knob to the middle of its control range and then fit the actuator onto the adapter already on the valve. The control knob shall be able to turn freely both to left and right by 45°. When turned to the right by 45°, the path 1 is closed, and when turned to the left by 45° the path 3 is closed. Having performed the check, turn the knob back to automatic control.



After the actuator is fitted, the correct position of the round indication label (hot/cold, red/blue) shall be checked as to the right function and position of the valve.

In case of a vertical installation in central heating, the red mark on the label shall be on the right-hand side for left-hand installations (see Fig. 5) and and on the left-hand side for right-hand installations (see Fig. 6).





Fig. 5 Fig. 6

In case of a horizontal installation with a solid fuel boiler, the red mark on the label shall be on the right-hand side for right-hand installations (boiler to the left from the pump station, see Fig. 7) and on the left-hand side for left-hand installations (boiler to the right from the pump station, see Fig. 8).

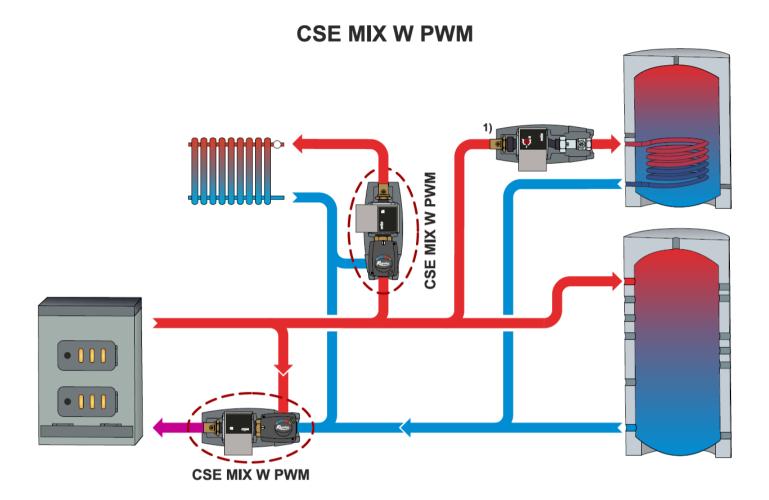




Fig. 7 Fig. 8

# 4. Pump Station Connection Diagram

The pump station may be installed in either horizontal or vertical position.




1) CSE OTS ZV W - Code 15892 CSE OTS ZV W PWM - Code 17284

# 5. LK Mixing Valve



Technical data		
Working temperature	5 - 110 °C (120 °C in short term)	
Max. working pressure	10 bar	
Ambient working temperature	5 - 60 °C	
Valve K <sub>vs</sub>	10,0 m³/h	
Max. pressure difference	5 m H <sub>2</sub> O	
Leakage rate	< 1% K <sub>vs</sub> at 5 m H <sub>2</sub> O pressure difference	
Connections	3 x G 1" F	

Materials	
Valve housing, spindle, member	brass
Seal	EPDM

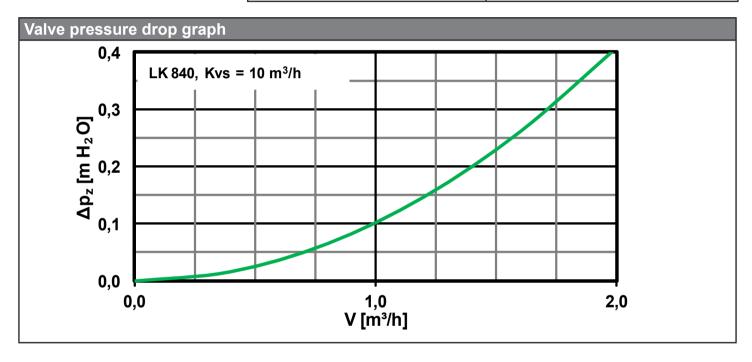


# **6. Mixing Valve Actuator**




Technical data	
Torque	5 Nm
Angle of rotation	90°
Shift time	120 s
Control	3-point
Auxiliary switch	none
Power supply	230 V AC
Max. power input	2.5 VA
IP rating	IP42
Protection class	II by EN 60730-1
Ambient temperature	0 - 40 °C
Cable (cross section area - length)	3 x 0.5 mm <sup>2</sup> - 2 m

# actuator wiring

- marking 1, 2, 3 located on the cables

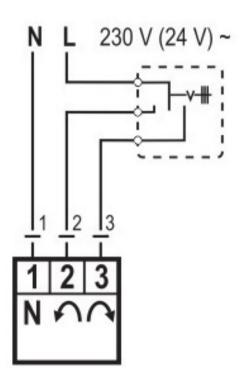



## 7. YONOS PARA RS 25/7.5 PWM1 130 mm Pump

### Design


Wet-running circulation pump with G 6/4" M connection.


Electrical data		
Power supply	1~230 V, 50/60 Hz	
Power input (min./max.)	4/75 W	
Current (min./max.)	0.04/0.66 A	
IP rating	IPX4D	
Max. speed	4770 rpm	
Energy Efficiency Index	≤ 0,21 by EN 16 297/3	
Motor protection	integrated	


Minimum pressure at the suction port	
Min. pressure at the suction port to avoid	0.5 m at 50 °C
cavitation	4.5 m at 95 °C

Operation data	
Fluid working temp.	0 - 100 °C at 58 °C ambient temperature
Max. working pressure	6 bar
Max. head	7.6 m

### Wilo Yonos PARA RS 25/7,5 PWM1 pump wiring





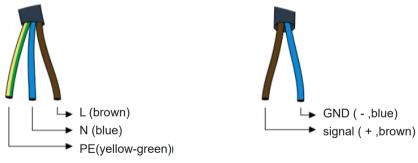

Pump power cable and PWM communication cable included in supply.

#### **Performance curves**

#### **External control via PWM 1**

