

Regulus

www.regulus.eu



HSK 350 K P-B

Installation and Operation Manual
THERMAL STORE
with stainless-steel DHW heat exchanger
HSK 350 K P-B

EN

HSK 350 K P-B

CONTENTS

1 Description	3
1.1 Models	3
1.2 Tank protection	3
1.3 Thermal insulation	3
1.4 Packaging	3
2 General Information	3
3 Technical Data and Dimensions of HSK 350 K P-B Thermal Store	4
4 Operation	5
5 Connection of HSK 350 K P-B to a Heating System	6
6 Installation and Commissioning	7
6.1 Connection to heat sources	7
6.2 Connection to water mains	7
6.3 Commissioning	7
7 Installing Insulation on the Tank	7
8 Maintenance	8
9 Disposal	8
10 Warranty	8

1 - Description

The HSK 350 K P-B Combination Thermal Store with an integrated stainless-steel heat exchanger and a tight separating metal plate is intended for storing heat and heating of domestic hot water. Thanks to the modified construction and the tight separating plate, it is sufficient to use only one zone valve for switching between heating the upper and lower part of the tank. The tank is suitable for installations with heat pumps and a RegulusBOX indoor unit.

1.1 - Models

One model of 340 l total volume with stainless-steel DHW heat exchanger.

1.2 - Tank protection

The thermal store has no inner surface finish, the outer surface is painted in gray. The DHW heat exchanger is made of stainless steel.

1.3 - Thermal insulation

Thermal insulation is available as a separate item. For easier handling, the insulation shall not be fitted on the tank until it reaches its definite place of installation. The insulation is made of fleece, 100 mm thick, with a hard polystyrene surface.

1.4 - Packaging

Thermal stores are delivered standing, each screwed to its pallet, packed in bubble wrap

It is forbidden to transport and/or store the thermal stores in a horizontal position.

2 - General Information

This Manual is an integral and important part of the product and must be handed over to the User. Read carefully the instructions in this Manual as they contain important information concerning safety, installation, operation and maintenance. Keep this Manual for later reference.

This appliance is designed to accumulate thermal energy and distribute it subsequently. It must be connected to a heating system and heat sources. This appliance is suitable for continuous heating of domestic hot water.

Using the thermal store for other purposes than above described is forbidden and the manufacturer accepts no responsibility for damage caused by improper or wrong use or filling procedure.

The appliance shall be installed by a qualified person according to valid rules, otherwise the warranty becomes null and void.

3 - Technical Data and Dimensions of HSK 350 K P-B Thermal Store



Main Features	
Application	Combination thermal store with integrated stainless-steel heat exchanger and a tight separating metal sheet is intended for heat accumulation and DHW heating. Thanks to its modified design and the tight separating metal sheet, just one zone valve is sufficient for switching between heating the upper and lower tank sections. The tank is suitable for installations with heat pumps and RegulusBOX indoor unit. The tank insulation is not included in supply and shall be ordered separately, see the code below.
Working fluid	Water (heat exchanger), water; water-glycol mixture (max. 1:1) or water/glycerine mixture (max. 2:1 (thermal store)).
Thermal store code	18628
Insulation code	18837

Energy Efficiency Data (as per EC Regulation No. 812/2013)	
	valid for a thermal store with insulation
Energy efficiency class	C
Static loss	74 W
Storage volume	340 l

Technical data	
Total thermal store volume	340 l
Fluid volume in thermal store	319 l
Fluid volume above separating plate	200 l
Fluid volume below separating plate	119 l
Fluid volume of DHW heat exchanger above the separating plate	21.0 l
Surface area of DHW heat exchanger above the separating plate	6.0 m ²
Max. working temperature in thermal store	95 °C
Max. working temperature in DHW heat exchanger	95 °C
Max. working pressure in thermal store	4 bar
Max. working pressure in DHW heat exchanger	10 bar
Thermal store diameter	550 mm
Thermal store diameter with insulation	750 mm
Thermal store overall height	1655 mm
Tipping height without insulation	1740 mm
Thermal store perimeter insulation thickness	100 mm
Thermal store bottom insulation thickness	50 mm
Thermal store top insulation thickness	100 mm
Empty weight without insulation	78 kg

Materials	
Thermal store material	S235JR
Thermal store perimeter insulation	fleece
Thermal store outer surface insulation	hard polystyrene
Top and bottom thermal store insulation	fleece
DHW heat exchanger	AISI 316 L

Insulation thermal conductivity $\lambda \leq 0.037$ W/mK, thermal resistance (short/long term) 150/100 °C, fire class E.

Volume of supplied DHW (heated from 10 °C to 40 °C)				
Heated volume	Temperature in thermal store	Backup heater	Flow rate [l/min]	Hot water volume [l]
Entire	50 °C	10 kW	8	207
			12	165
			20	132
Entire	50 °C	none	8	165
			12	135
			20	111
Above metal sheet	50 °C	10 kW	8	197
			12	159
			20	127
Entire	60 °C	10 kW	8	287
			12	261
			20	218
Entire	60 °C	none	8	229
			12	211
			20	174
Above metal sheet	60 °C	10 kW	8	273
			12	248
			20	210


Dimensions		CONNECTIONS			
		pos.	description	connection	height [mm]
	Heat sources				
	B1	Supply from heat source	G 1" F	390	
	B2	Return to heat source	G 1" F	630	
	B3	Supply from heat source	G 1" F	1170	
	Heating system				
	H1	Flow to heating system	G 1" F	530	
	H2	Return from heating system	G 1" F	210	
	DHW heating				
	W1	Cold water	G 1" F	725	
	W2	Domestic hot water	G 1" F	775	
	Control and safety				
	C1	Temperature sensor	G 1/2" F	500	
	C2	Temperature sensor	G 1/2" F	940	
	T	Thermometer	G 1/2" F	1380	
P	Safety valve	G 1/2" F	210		
Air discharge					
O	Air vent valve	G 1/2" F	1655		

4 - Operation

This tank is designed for storing heating water in closed pressure circuits with forced circulation. The stored heating water transfers its heat to domestic hot water via the integrated heat exchanger. Hot water is thus heated in a continuous manner.

The tank is suitable for installations with heat pumps and a RegulusBOX indoor unit.

5 - Connection of HSK 350 K P-B to a Heating System

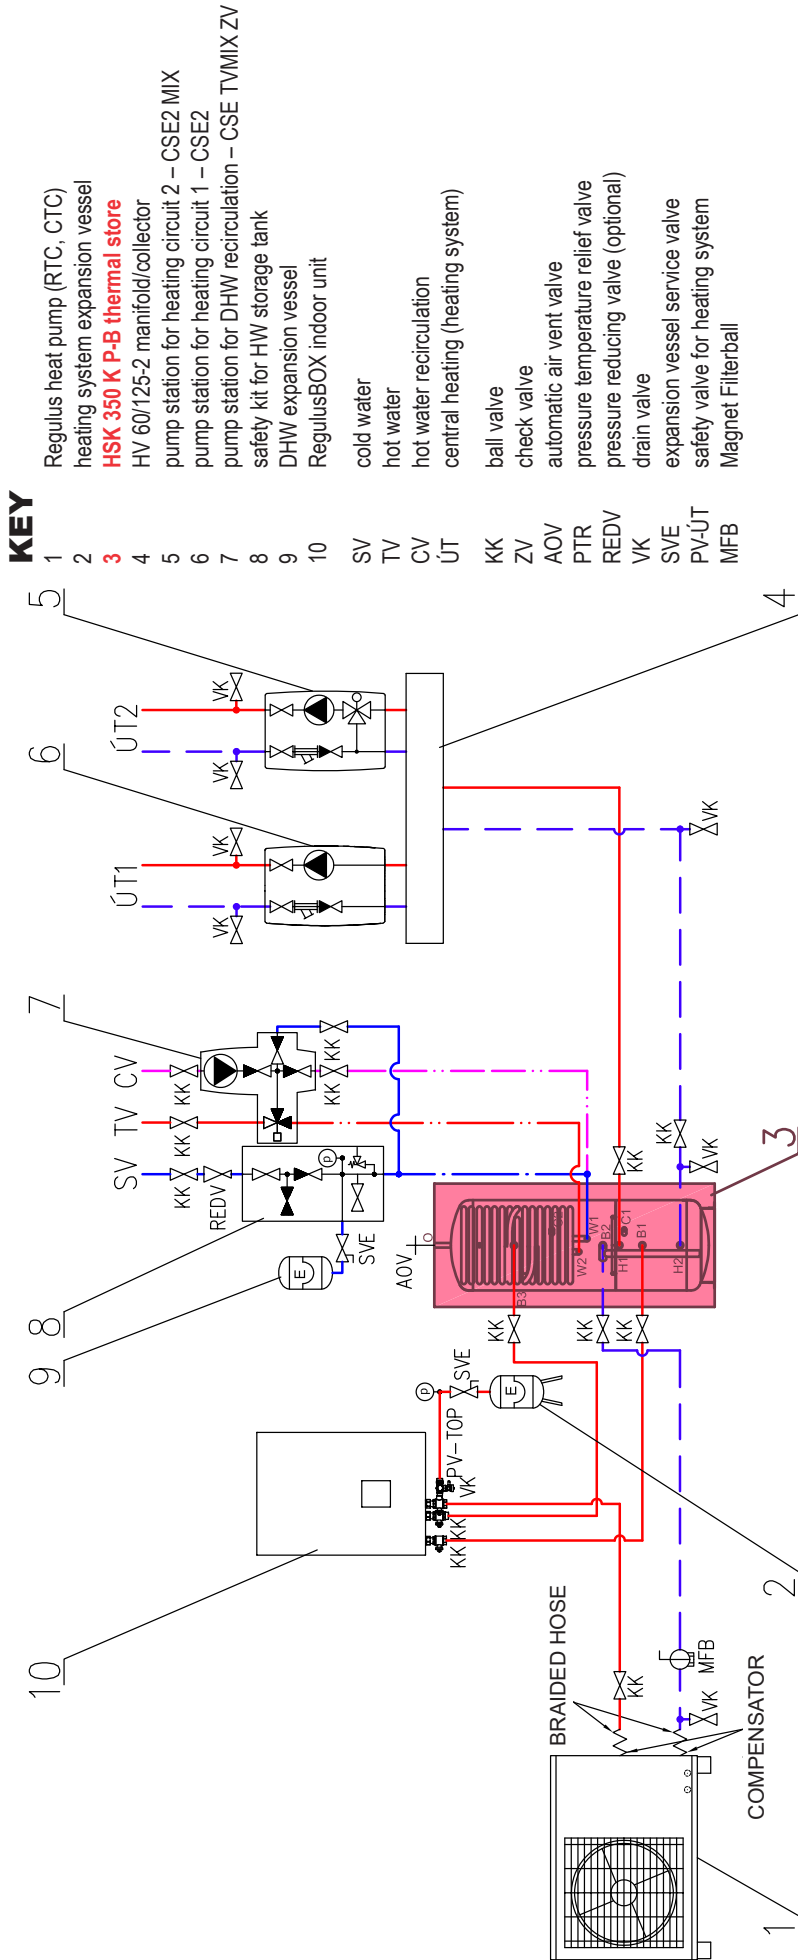

6 - Installation and Commissioning

Installation must meet valid rules and may be done only by qualified staff.

Defects caused by improper installation, use or handling are not covered by warranty.

After the tank is installed and connected to an existing heating system, it is recommended to clean the entire heating system using a suitable cleaning agent, e.g. MR-501/R.

Anti-corrosion protective liquid should be also used, e.g. MR-501/F.

6.1 - Connection to heat sources

Place the tank on the floor and level it. Fit the insulation, see Installing Insulation on the Tank. Connect the heating system according to the diagram of recommended connection - see Chap. 5. Install a drain valve at the lowest point of the tank. Install an air vent valve at the highest point of the system. Insulate all the connection piping.

6.2 - Connection to water mains

DHW piping shall be done according to valid rules. The connections to the tank including the location of components is shown in the recommended connection diagram in chapter 5. Installation of a pressure reducing valve on the tank inlet is recommended. For water mains pressure above 6 bar a pressure reducing valve is necessary. Install a DHW expansion vessel of 2 l min. volume at the cold water inlet. Installation of the expansion vessel is a condition for the warranty to be valid. Should the water be too hard, install a water softener before the tank. In case the water contains mechanical impurities, install a filter.

Table of limit values for total dissolved solids in hot water

Description	pH	Total dissolved solids (TDS)	Ca	Chlorides	Mg	Na	Fe
max. value	6,5 - 9,5	600 mg/l	40 mg/l	100 mg/l	20 mg/l	200 mg/l	0,2 mg/l

6.3 - Commissioning

Ground the tank before commissioning.

The tank shall be filled up together with the heating system, respecting valid standards and rules. In order to minimize corrosion, special additives for heating systems should be used. The quality of heating water depends on the quality of filling water at commissioning, on the top-up water and on the frequency of topping up. This has a strong influence on the lifetime of heating systems. Poor quality of heating water may cause problems like corrosion or incrustation, esp. on heat transfer surfaces.

Quality of DHW shall meet the conditions shown in the Table of limit values for total dissolved solids in hot water on this page.

Fill the heating circuits with the appropriate fluids and air-bleed the entire system. Check all connections for leaks and verify the system pressure. Set the heating controller in compliance with the documentation and manufacturer's recommendations. Check regularly the proper function of all control and adjustment elements.

7 - Installing Insulation on the Tank

Product description

Thermal insulation is part of the thermal store to reducing its heat loss. For easier handling, the insulation shall not be fitted on the tank until it reaches its definite place of installation.

Warning

Insulation installation shall be done in two persons. Do not use any tools for installation. Keep away from open fire.


Installing Insulation

1. Fix the tank following installation instructions.
2. Wrap the insulation around the tank carefully. Check that the insulation adheres to its body perfectly. This can be reached by rubbing and patting the insulation by hand from its center evenly in both directions until the insulation adheres to the tank's surface completely and no bubbles are left.
3. Use the holes for connections as a rest during the insulation installation.
4. At least one person presses the insulation to the tank, pulling both ends together. The other person closes the insulation lock from the side.
5. Put on the upper insulation and cover.
6. Push on the covering plastic rosettes depending on the size of connections.
7. Finish the tank installation in compliance with the respective instructions and valid standards and rules.

Warranty on insulation

- Warranty shall become null and void if:
 - the procedure described in the Installation Manual was not respected
 - the product was used for other purposes than intended.
- Warranty does not cover:
 - usual wear and tear,
 - damage caused by fire, water, electricity or a natural disaster,

- defects caused by failure to use the product in compliance with its intended purpose, by improper use and insufficient maintenance,
- defects caused by mechanical damage to the product,
- defects caused by tampering or incompetent repair.

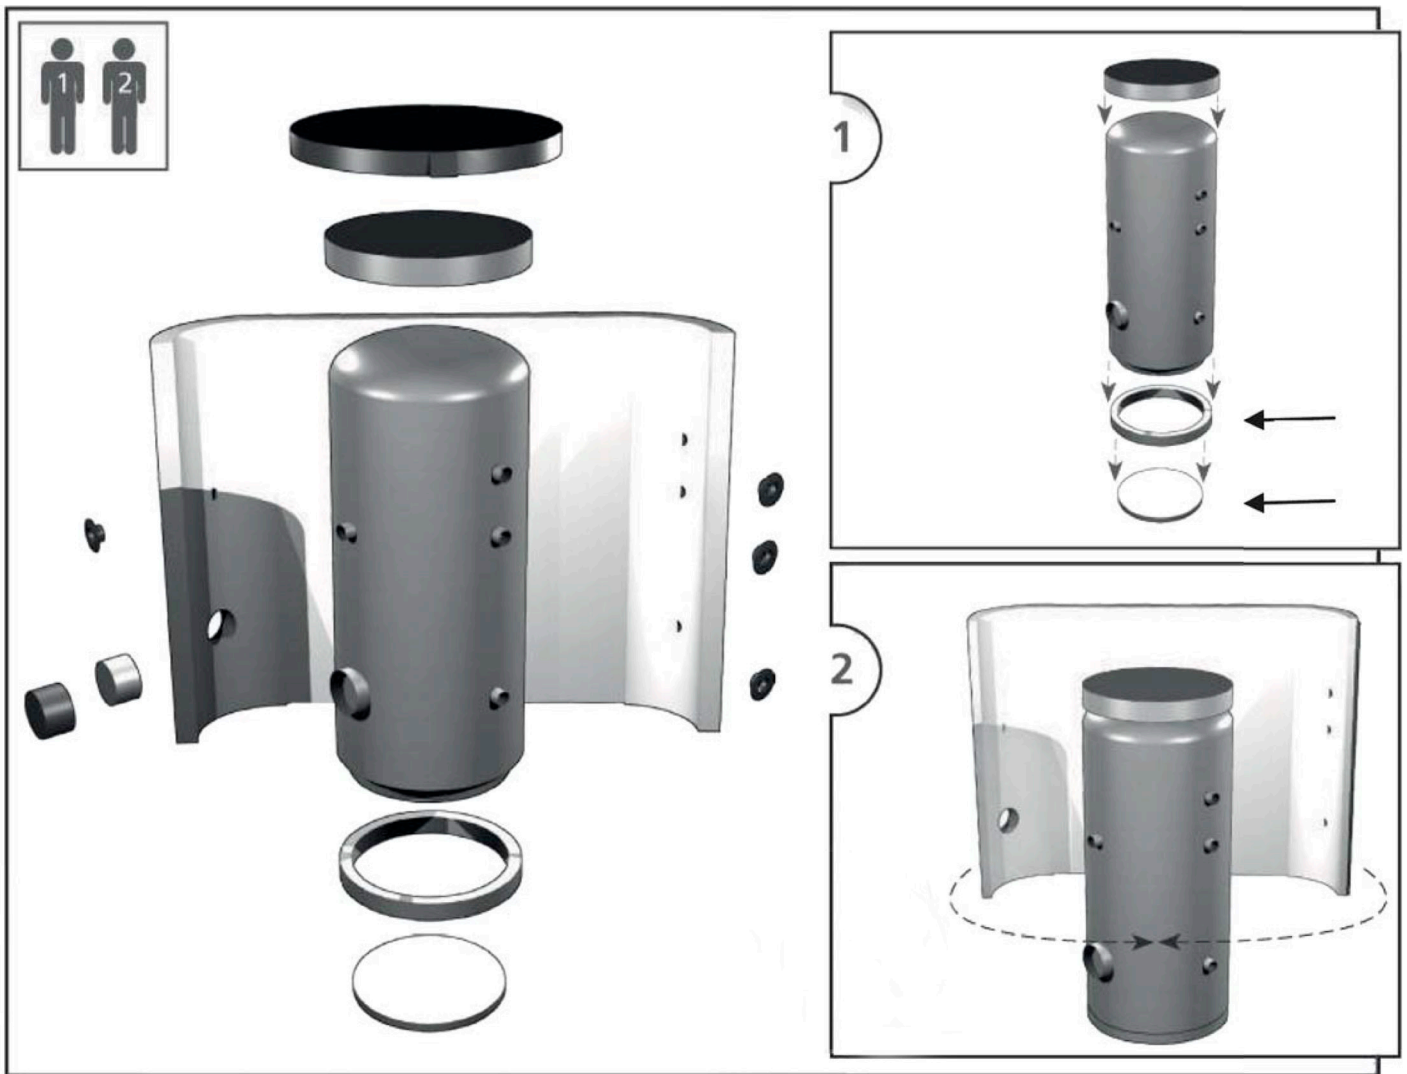

8 - Maintenance

Clean the exterior of the tank with a soft cloth and a mild detergent. Never use abrasive cleaners or solvents. Check all connections for leaks.

9 - Disposal

Packaging shall be disposed of in compliance with the valid rules. When the product reaches the end of its life, it shall not be disposed of as household waste. It shall be dropped off at a Local Waste Recycling Center. Insulation shall be recycled as plastic and the steel vessel as scrap iron.

10 - Warranty

This product is covered by warranty under conditions specified in this Manual and the respective Warranty Certificate. The Warranty Certificate is an integral part of supply of this Thermal Store.